

## SNS Application Programming Plan\*

C.M. Chu, J. Galambos, J. Wei<sup>†</sup>, ORNL, Oak Ridge, TN, USA

C. Allen, P. McGehee, LANL, Los Alamos, NM, USA

N. Malitsky, BNL, Upton, NY, USA

### Abstract

The plan for Spallation Neutron Source accelerator physics application programs is presented. These high level applications involve processing and managing information from the diagnostic instruments, the machine control system, models and static databases and will be used to investigate and control beam behavior. Primary components include an SNS global database and Java-based XAL Application Toolkit. A key element in the SNS application programs is time synchronization of data used in these applications, due to the short pulse (1 ms), pulsed (60 Hz) nature of the device. The data synchronization progress is also presented.

## 1 INTRODUCTION

The Spallation Neutron Source (SNS) is a high intensity pulsed accelerator for neutron production. To commission and run the SNS efficiently, we need high level physics application software for modeling, integrated operation and accelerator physics studies. In particular, we are constructing an object oriented accelerator hierarchy programming framework. We choose Java as the core programming language because it provides object-oriented scope and existing interfaces to the controls software (*e.g.* Java Channel Access) and database information (JDBC, XML). The SNS physics application software environment includes the SNS global database, a Java-based software infrastructure (XAL), and existing lattice tools such as Trace-3D and MAD. The core part of this environment is the XAL infrastructure, which includes links to the SNS database, EPICS Channel Access signals, shared extensible markup language (XML) files among applications and external modeling tools, as well as built-in accelerator physics algorithms. Data synchronization at the EPICS level for the SNS pulsed nature is also in progress, and will be included in the XAL infrastructure later.

## 2 SNS GLOBAL DATABASE

The SNS global database contains static information about beam line devices (magnets, diagnostics, etc.), power supplies, magnet measurement, global coordinates, as well as other accelerator equipment. The table schemas, entities

and relationships are described at [1]. The basic accelerator hierarchy is constructed from the database information. For example information for constructing representative beamline sequences, their constituent lattice and diagnostic components, and the mapping of beamline components to their respective EPICS Process Variables (PVs) all comes from the global database.

Although it is possible to directly query the database from the Java based XAL framework, instead we create an intermediate XML file containing the accelerator hierarchy. The structure of the XML files is based on the XAL class view. The global database to local XML file translation is a stand-alone program outside the XAL, which obviates the need for each XAL based applications to query the database for initialization.

## 3 XAL INFRASTRUCTURE

The XAL infrastructure is a Java class structure providing a programming interface with an accelerator hierarchy view. XAL is a variant of UAL, 2.0[2], and detailed API information for the XAL can be found on-line[3]. A schematic diagram depicting the XAL infrastructure relationship to other Accelerator components is shown in Fig. 2. The XAL provides application programs with connections to the static data via XML files and the run-time data via Java Channel Access.

The XAL class hierarchy is shown in Fig. 2. At the top of the XAL class hierarchy is the SNS accelerator. The accelerator is composed of different Accelerator sequences (*e.g.* Medium Energy Beam Transport, Drift Tube Linac, Ring, etc). The sequences are composed of nodes (*e.g.* Quadrupoles, BPMs, Correctors, etc.). There is a builtin capability to include algorithms in XAL, but initially we are using an external model (Trace-3D) for the linac applications. Regarding scripting possibilities, we are testing the use of XAL class objects directly with Jython, without need for any interface code.

### 3.1 EPICS Channel Access

All the run-time information for the applications will be obtained through EPICS Channel Access. The XAL provides the connectivity to the EPICS Channel Access via the ca classes as shown in Fig. 2. Because the SNS is a pulsed machine, for many applications the data correlation among

\* Work supported by DOE contract DE-AC05-00OR22725

<sup>†</sup> also at BNL

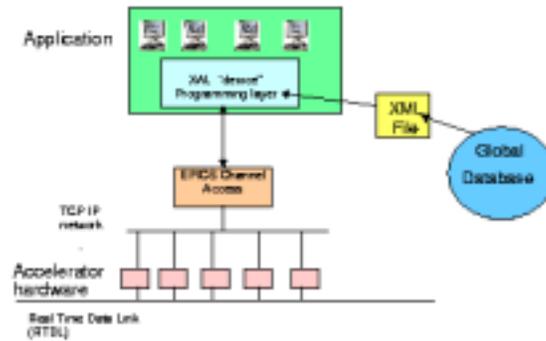


Figure 1: Application software infrastructure.

pulses is vital. The ca classes provide both synchronized and non-synchronized methods for data taking. The data synchronization will be described in detail in Sec 4.

### 3.2 Links to External Modeling Tools

Most of the existing accelerator modeling software packages are written in languages other than Java. To be able to run these programs from Java-based XAL, first we need to compile these programs as shared libraries; the XAL then connects to the shared libraries via the Java Native Interface (JNI). The file I/O is done through XML parsing provided by the XAL, *i.e.* storing the calculated result in XML files, thus the information is portable and share-able, and can be also be accessed remotely. The JNI calls also require carefully arranging the running threads because normally programs tend to execute its own threads before starting the non-Java threads.

## 4 DATA SYNCHRONIZATION

Data synchronization is an important feature for a pulsed accelerator (1 msec beam pulses at 60 Hz). The SNS Real Time Data Link will transmit a timestamp to all IOCs across the accelerator at 60Hz, ensuring a good synchronization of the time-stamps being applied to PVs. However, it may be difficult for high level applications to reliably gather sets of data from across the accelerator, all from the same pulse. To facilitate this, a data-silo data time correlator is being written. The data-silo method is shown schematically in Fig. 3. The correlator returns the most recent set of time correlated sets of PV data for the requested PV set.

The behavior of the DataSilo class is configurable by three parameters: the maximum time to wait since start of request, maximum width of the time bin, and the maximum number of channels allowed to be missing from the synchronized data set. The correlator is implemented as the C++ DataSilo class which allows the application's programmer to:

- add and remove EPICS process variables from the DataSilo set;
- dynamically define the maximum wait time, maximum bin number, and maximum missing bins allowed;
- obtain the most recent synchronized set (no waiting); wait up to the maximum wait seconds to obtain a synchronized set (blocks)
- choose the earliest, latest, or mean time stamp from a synchronized set.

## 5 CONCLUSION

The SNS global database is close to the end of design phase and has been tested with SNS MEBT data. The XAL infrastructure is been constructed and tested with a modeling tool, Trace-3D. The Channel Access part of the XAL will be tested with faked IOC signals. Scripting tools such as Matlab and Python will be used in the MEBT commissioning this coming spring.

## 6 ACKNOWLEDGMENTS

We would like to thank the SNS Controls, and Diagnostics groups for kindly Providing EPICS, database and other support.

## 7 REFERENCES

- [1] <http://ntser3.cad.ornl.gov/mis/EnterpriseModel/modell.htm>.
- [2] N.Malitsky, *et al.* "A Prototype of the UAL 2.0 Application Toolkit", THAP013, ICALEPCS 2001 Conference.
- [3] <http://sns.gov/APGroup/appProg/xalDoc/>.

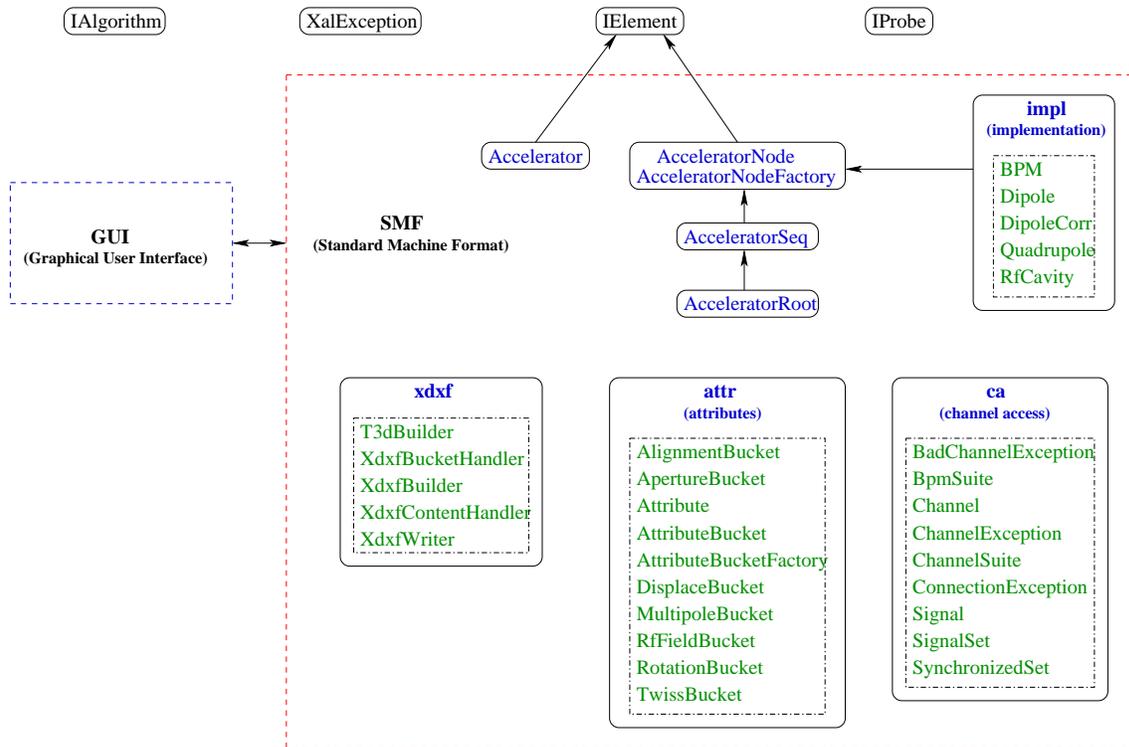


Figure 2: XAL infrastructure.

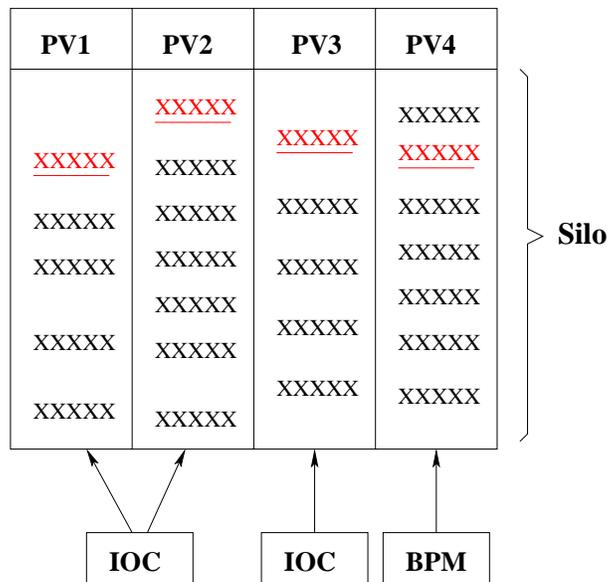


Figure 3: Data-silo for data synchronization.